

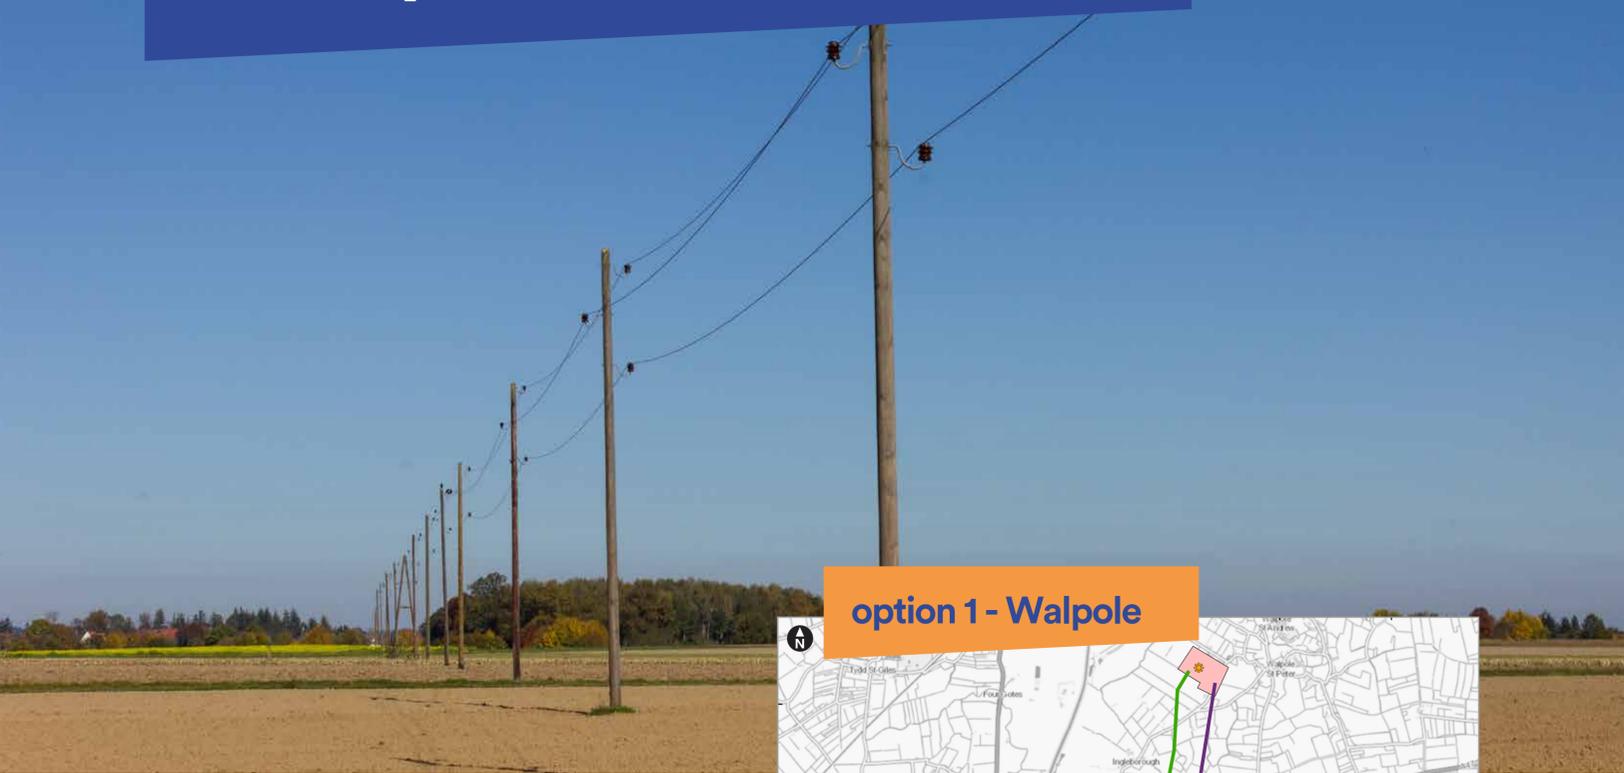


grid connection options

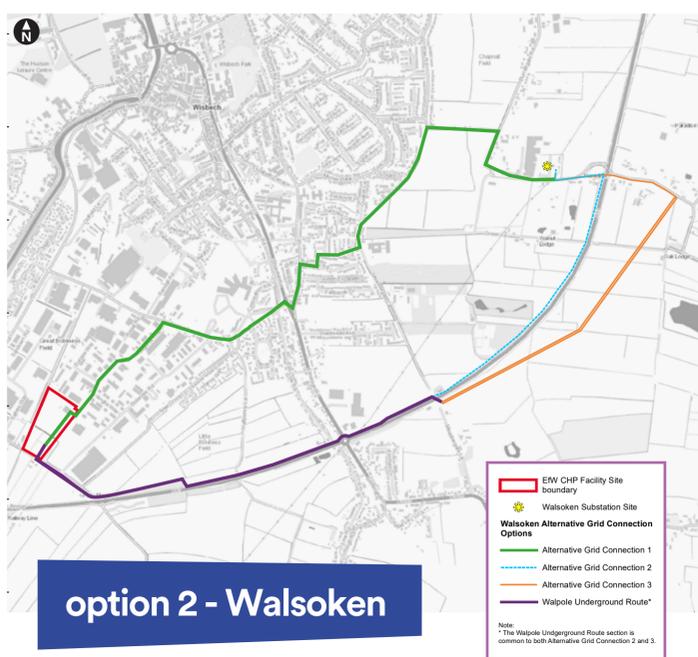

Initial discussions focused on **Walpole sub-station...**

Initial discussions and meetings with UK Power Networks, in August 2019, determined that a connection to the sub-station at Walsoken would not be possible. Design and survey work therefore focused on the longer connection to Walpole sub-station, as reported in the Medworth Grid Corridor Options Report September 2020; this was presented at our non-statutory consultation in autumn last year.

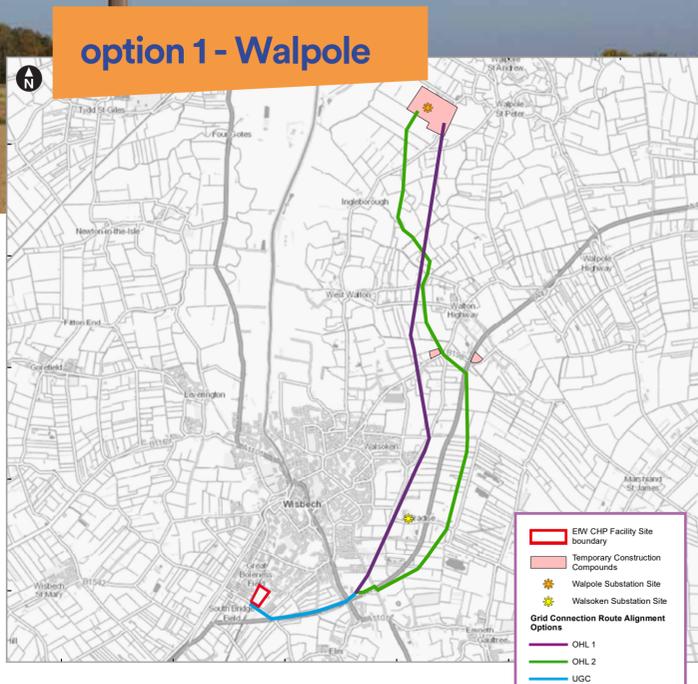

Further analysis showed **Walsoken could be an option...**

Further analysis by UK Power Networks showed that a point of connection could be made at Walsoken so we have also looked at this much shorter route in more detail. Three possible routes from the facility to the sub-station at Walsoken were considered, based on three factors:

 Environmental

 Technical

 Land use

We will continue to review the options and develop more detailed designs, taking into account any relevant comments and feedback received through the statutory consultation.



www.mvv-medworthchp.co.uk